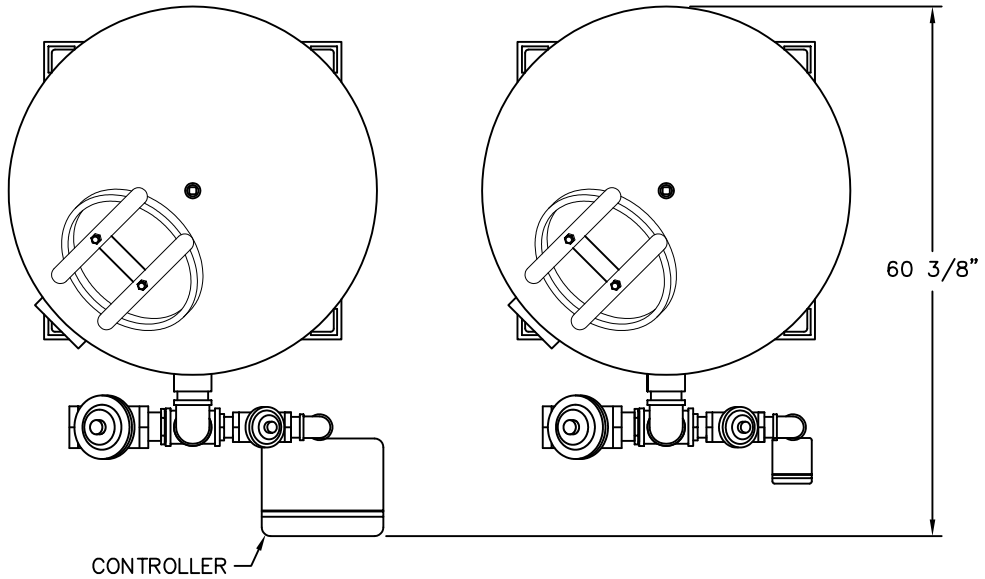

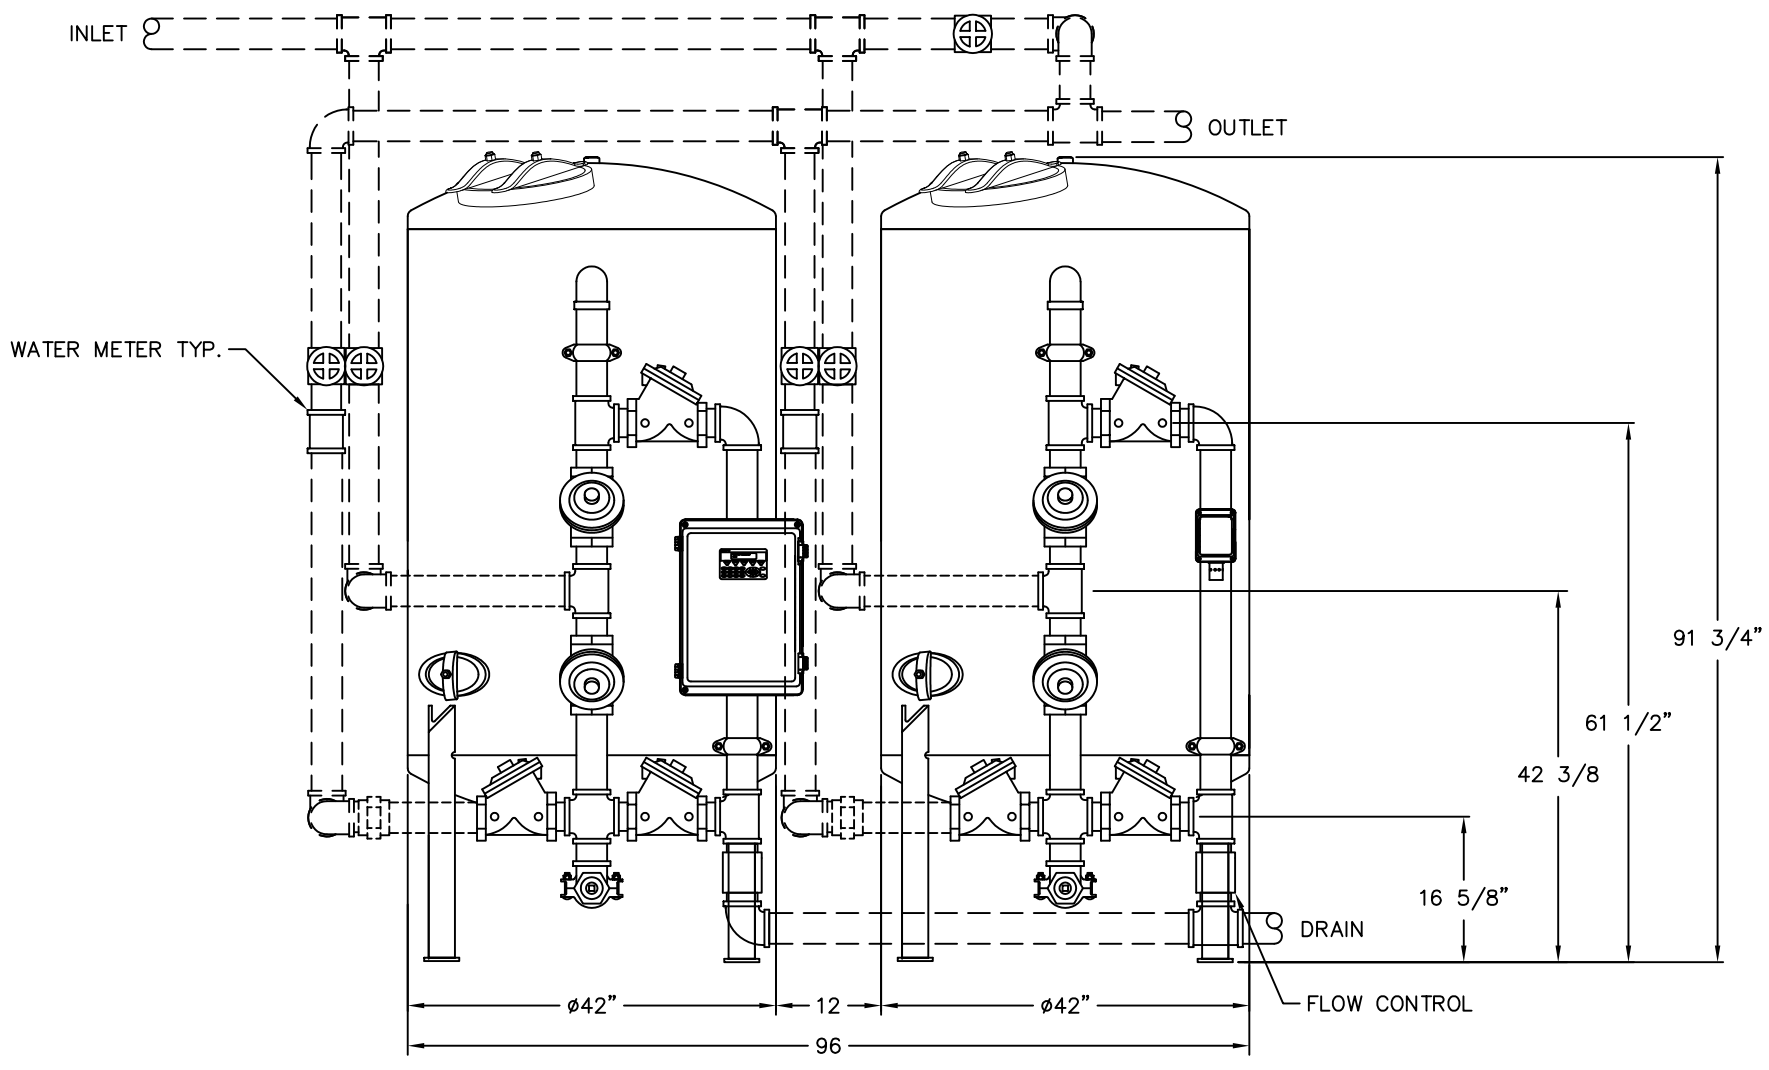

1. ALL PIPE, FITTINGS, ETC. SHOWN IN BROKEN LINES TO BE FURNISHED BY CUSTOMER.
2. ADEQUATE SPACE SHOULD BE PROVIDED AROUND AND NEAR THE EQUIPMENT TO ALLOW FOR GENERAL MAINTENANCE AND MAINTAINING SALT STORAGE.
3. ALL DRAINS SHOULD BE PLUMBED WITH A PHYSICAL AIR GAP OF AT LEAST FOUR TIMES THE DIAMETER OF THE DRAIN LINE, TO PREVENT DRAIN BACKUP FROM ENTERING THE MINERAL TANK.
4. BE SURE TO FOLLOW ALL LOCAL AND STATE PLUMBING AND ELECTRICAL CODES.
5. ON APPLICATIONS REQUIRING WATER METERS, REFER TO INSTALLATION INSTRUCTIONS BEFORE INSTALLING.
6. PIPING SUPPORT IS EXTREMELY IMPORTANT, UNDUE STRESS ON CONTROL VALVE CAN RESULT IN SYSTEM FAILURE.
7. ALL DIMENSIONS ARE APPROXIMATE.
8. WATER METER SHOWN IS FOR REFERENCE ONLY, ACTUAL WATER METER USED MAY VARY ACCORDING TO CUSTOMER REQUIREMENTS.

REVISIONS			DRAWN BY: D. FISH
			CHK'D BY:
NO.	DATE	BY	SCALE:
1			Dwg: 1 OF 1
2			REV.#: NC
3			DATE: 3-27-06
4			ACS-4260-DV-3, TWIN COMMERCIAL / INDUSTRIAL STEEL, WATER
5			FILTER, PIPING & DIMENSIONAL DATA
6			CUSTOMER:
7			DRAWING NO.: ACS4260DV3-TW.DWG

Mueller
WATER CONDITIONING, INC.

REVISIONS:

THIS DRAWING IS THE PROPERTY OF MUELLER WATER CONDITIONING INC. - REPRODUCTION BY PERMISSION ONLY